


# Lift Access CTR 16 Configuration

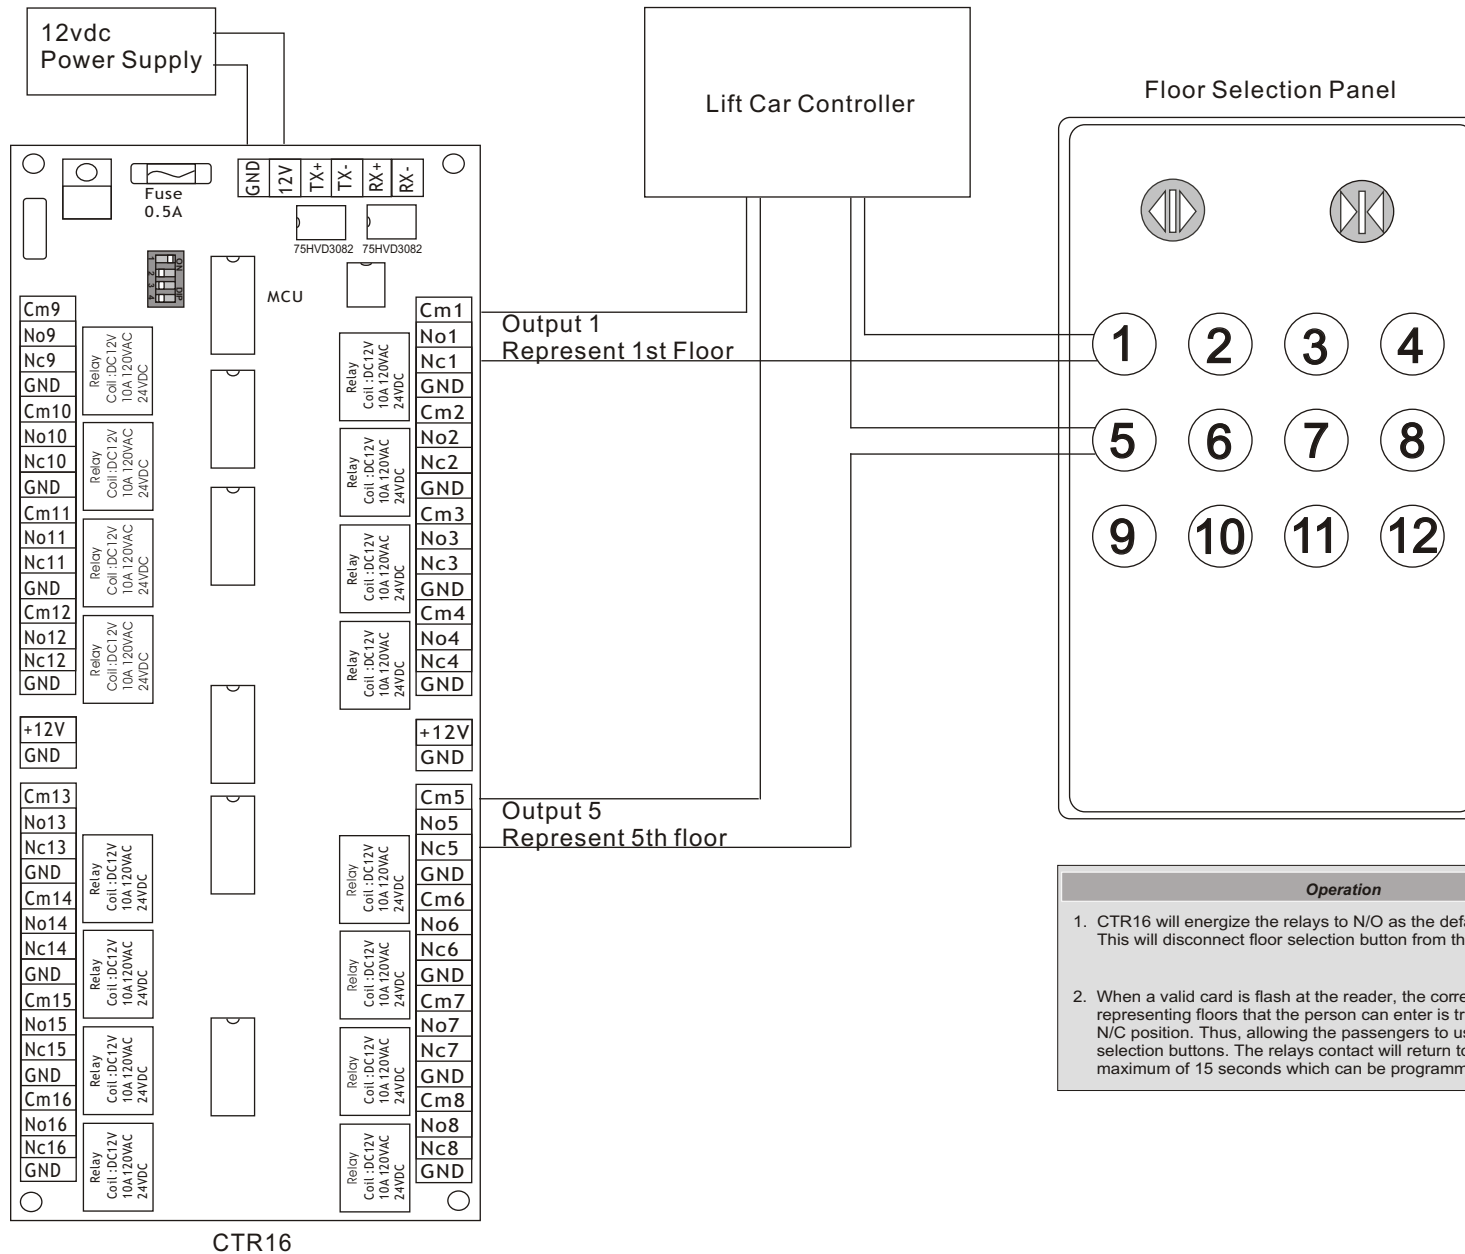

**Operation**

- CTR16 will energize the relays to N/O as the default position. This will disconnect floor selection button from the lift controller.
- When a valid card is flash at the reader, the corresponding relay representing floors that the person can enter is triggered to the N/C position. Thus, allowing the passengers to use the floor selection buttons. The relays contact will return to N/O position after maximum of 15 seconds which can be programmed.

CTR16