


Scan-X Configuration Diagram

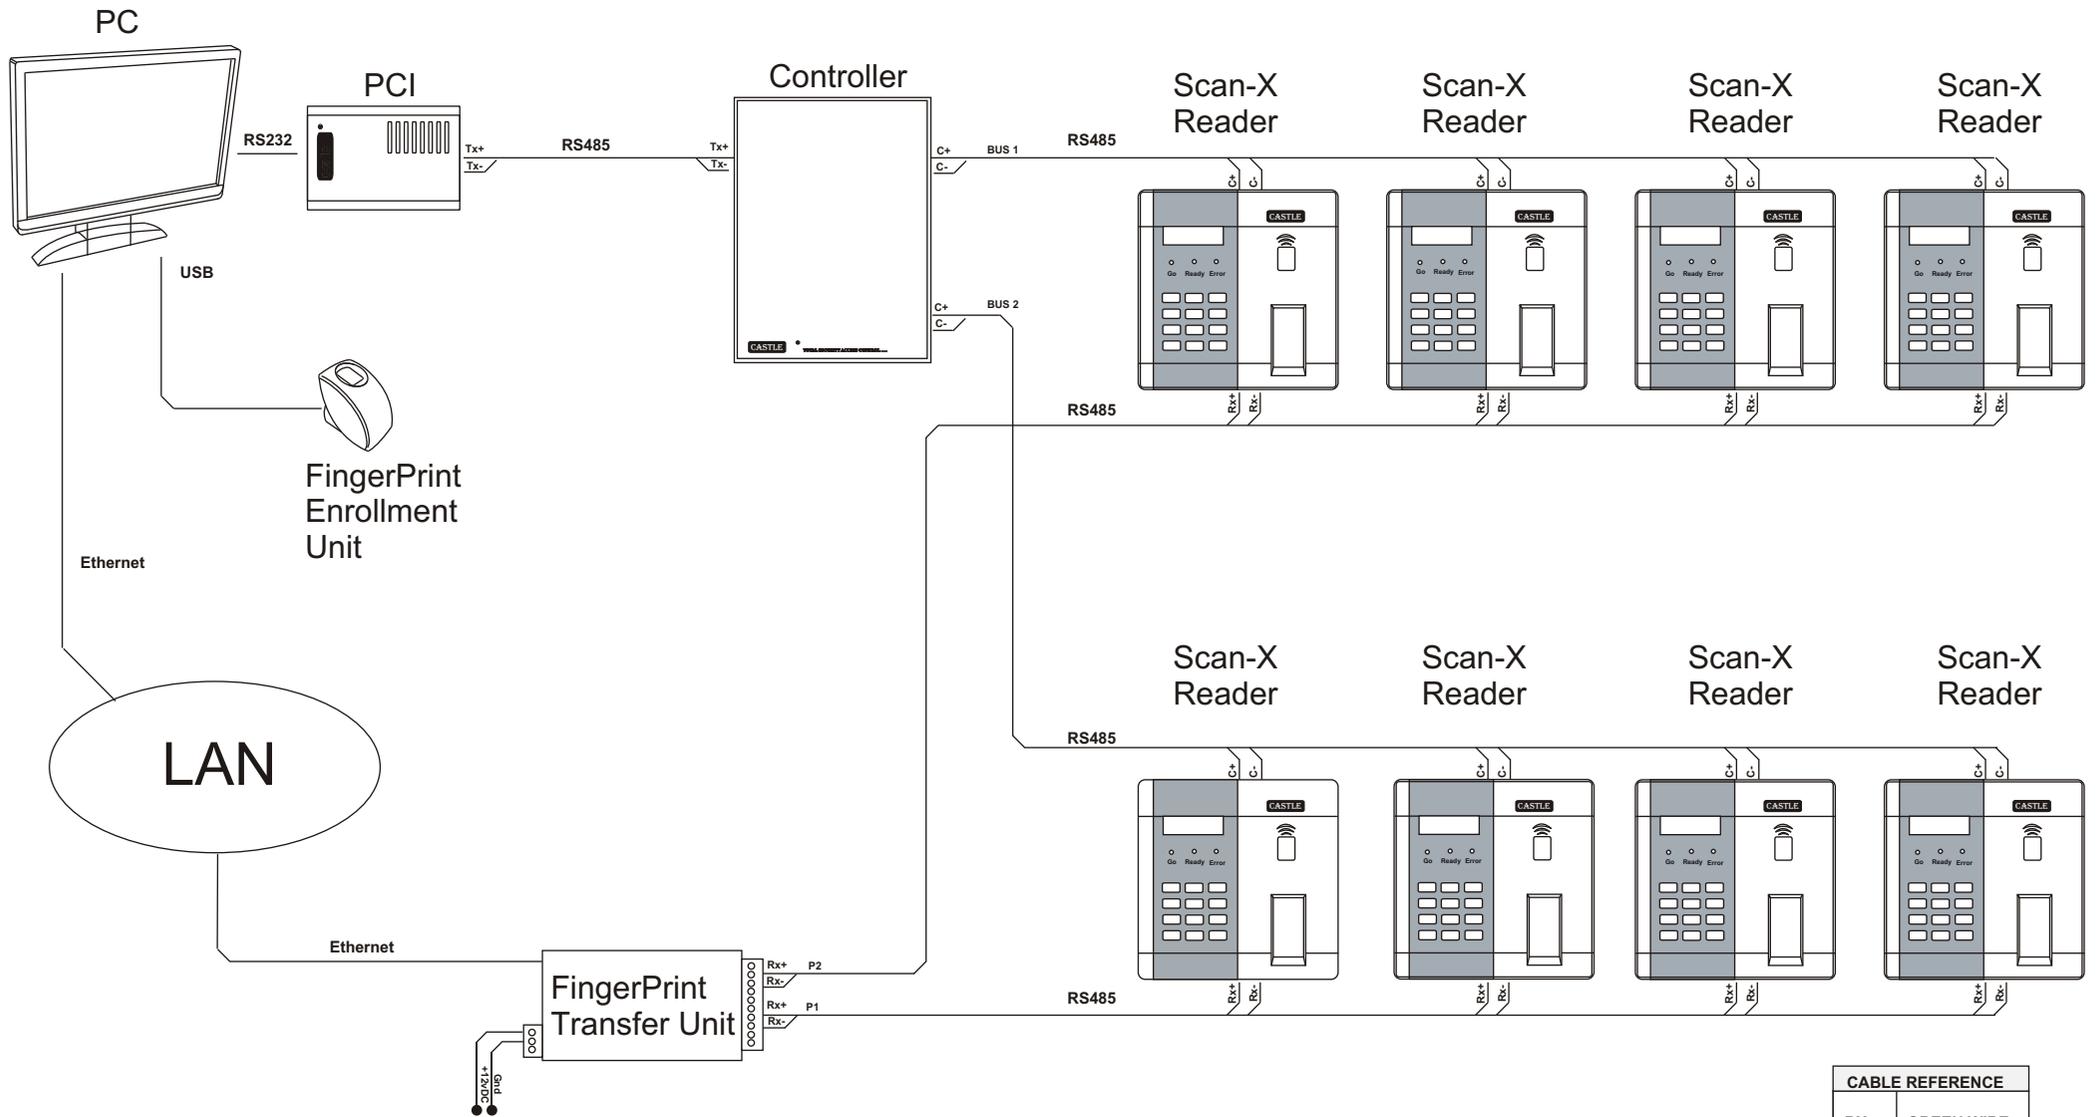

Remarks:

- All communication cable must be compliance to RS485 standard, with proper grounding & connected in multidrop connection.
- Reader address should not be the same.
- Module ID must unique on each bus.

CABLE REFERENCE	
RX+	GREEN WIRE
RX-	YELLOW WIRE

File	ScanX CONFIG v1.4
Date	200805
Company	Cass Technology Sdn Bhd