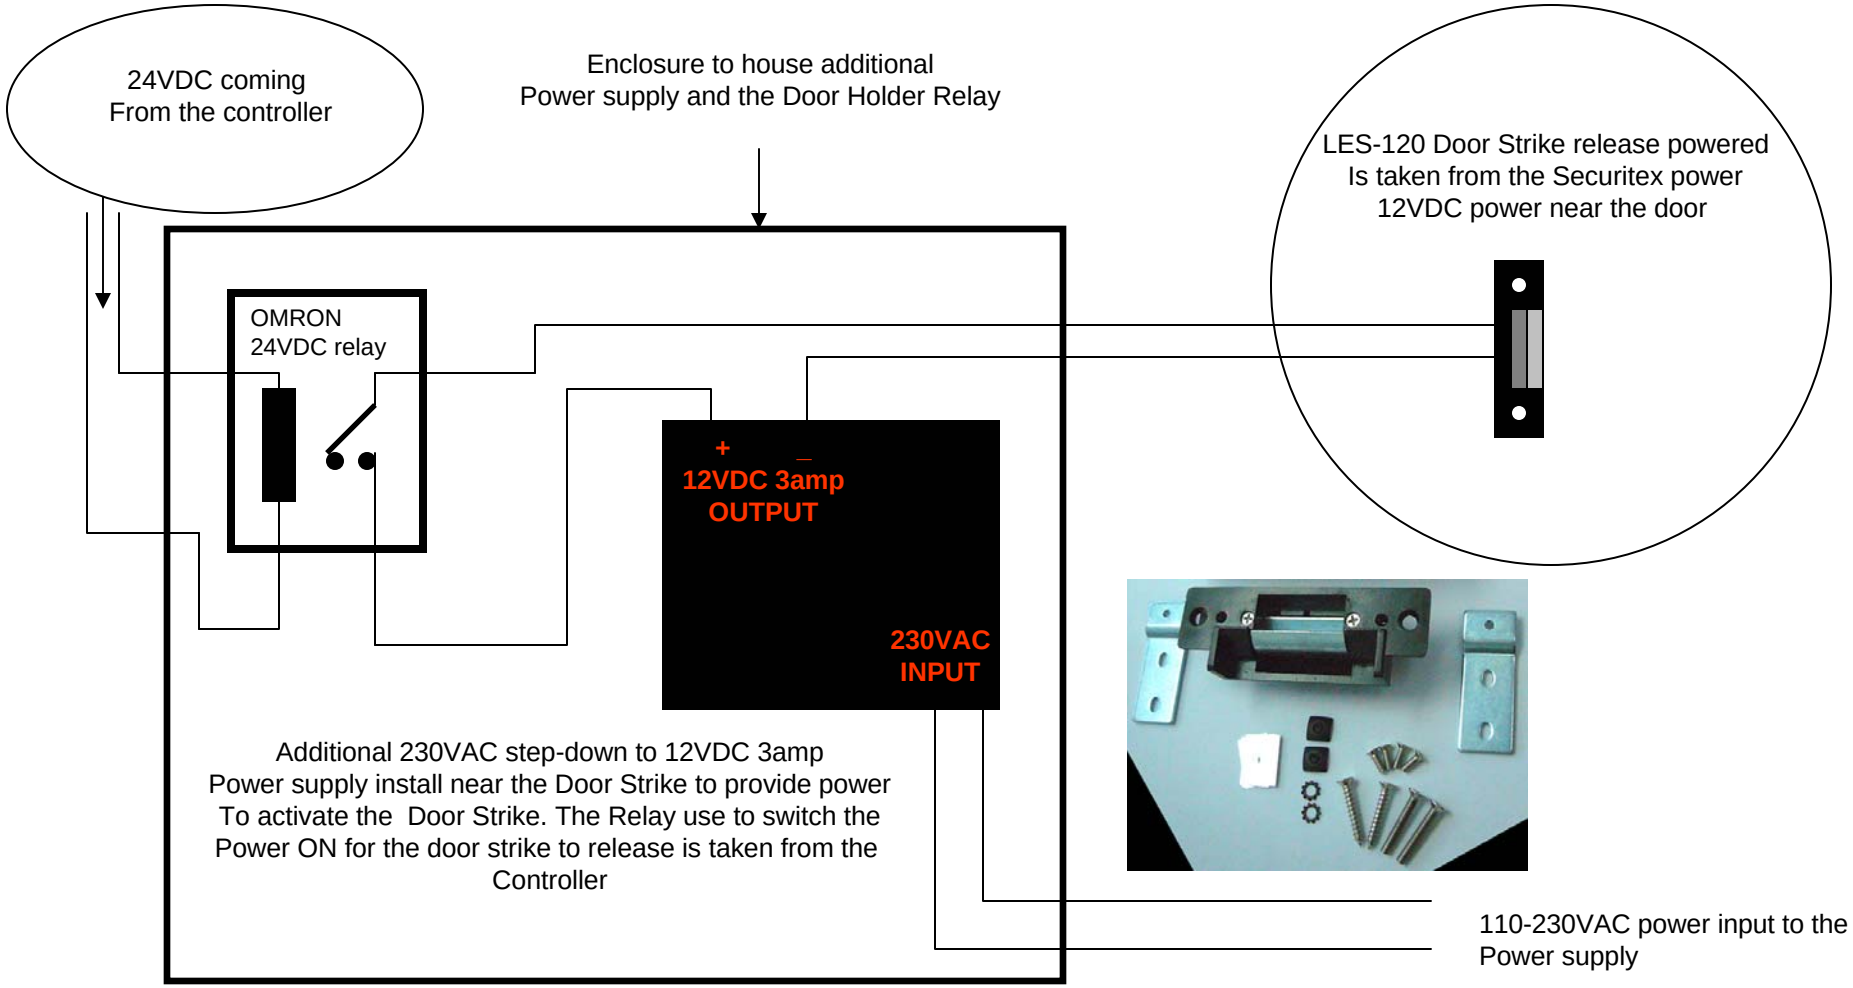
24VDC coming
From the controller
Enclosure to house additional
Power supply and the Door Holder Relay
LES-120 Door Strike release powered
Is taken from the Securitex power
12VDC power near the door
OMRON
24VDC relay
+
–
12VDC 3amp
OUTPUT
230VAC
INPUT
Additional 230VAC step-down to 12VDC 3amp
Power supply install near the Door Strike to provide power
To activate the Door Strike. The Relay use to switch the
Power ON for the door strike to release is taken from the
Controller
110-230VAC power input to the
Power supply